



ETA-Danmark A/S  
Göteborg Plads 1  
DK-2150 Nordhavn  
Tel. +45 72 24 59 00  
Fax +45 72 24 59 04  
Internet [www.etadanmark.dk](http://www.etadanmark.dk)

Authorised and notified according  
to Article 29 of the Regulation (EU)  
No 305/2011 of the European  
Parliament and of the Council of 9  
March 2011

MEMBER OF EOTA



## European Technical Assessment ETA-19/0705 of 2020/10/30

### I General Part

**Technical Assessment Body issuing the ETA and designated according to Article 29 of the Regulation (EU) No 305/2011: ETA-Danmark A/S**

**Trade name of the construction product:**

Chemfix 100 and Chemfix 600 injection system for concrete

**Product family to which the above construction product belongs:**

Bonded injection type anchor for use in concrete

**Manufacturer:**

Chemfix Products Ltd  
Mill Street East  
Dewsbury  
West Yorkshire  
WF12 9BQ, UK  
Tel. +44 (0) 1924 453886  
Fax +44 (0) 1924 431658  
Internet [www.chemfix.co.uk](http://www.chemfix.co.uk)

**Manufacturing plant:**

Chemfix Products Ltd  
Mill Street East  
Dewsbury  
West Yorkshire  
WF12 9BQ, UK

**This European Technical Assessment contains:**

28 pages including 21 annexes which form an integral part of the document

**This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of:**

EAD 330499-00-0601, "Bonded fasteners for use in concrete"

**This version replaces:**

The ETA with the same number issued on 2020-07-09

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full (except the confidential Annexes referred to above). However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

## **II SPECIFIC PART OF THE EUROPEAN TECHNICAL ASSESSMENT**

### **1 Technical description of product**

#### **Technical description of the product**

The Chemfix 100 and Chemfix 600 injection system for concrete is a bonded anchor consisting of a cartridge with Chemfix 100 and Chemfix 600 injection mortar and a steel element. The designation Chemfix 100 and Chemfix 600 relates to the cartridge size only. The steel element consists of a commercial threaded rod with washer and hexagon nut in the range of M8 to M24 or a reinforcing bar in the range of diameter 8 to 25 mm.

The steel element is placed into a drilled hole filled with injection mortar and is anchored via the bond between metal part, injection mortar and concrete.

The product description is given in Annex A.

The characteristic material values, dimensions and tolerances of the anchors not indicated in Annexes shall correspond to the respective values laid down in the technical documentation<sup>1</sup> of this European Technical Assessment.

### **2 Specification of the intended use in accordance with the applicable European Assessment Document (hereinafter EAD)**

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The provisions made in this European Technical Assessment are based on an assumed intended working life of the anchor of 50 years.

The indications given on the working life cannot be interpreted as a guarantee given by the producer or Assessment Body, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

---

<sup>1</sup> The technical documentation of this European Technical Assessment is deposited at ETA-Danmark and, as far as relevant for the tasks of the Notified bodies involved in the attestation of conformity procedure, is handed over to the notified bodies.

### **3 Performance of the product and references to the methods used for its assessment**

#### **3.1 Characteristics of product**

##### **Mechanical resistance and stability (BWR 1):**

The essential characteristics are detailed in the Annex C.

##### **Safety in case of fire (BWR 2):**

Anchorage satisfy requirements for Class A1.

No performance is assessed for resistance to fire.

##### **Hygiene, health and the environment (BWR3):**

No performance assessed

##### **Safety in use (BWR4):**

For basic requirement Safety in use the same criteria are valid for Basic Requirement Mechanical resistance and stability (BWR1).

##### **Sustainable use of natural resources (BWR7)**

No performance assessed

Other Basic Requirements are not relevant.

#### **3.2 Methods of assessment**

The assessment of fitness of the anchor for the intended use in relation to the requirements for mechanical resistance and stability and safety in use in the sense of the Basic Requirements 1 and 4 has been made in accordance with EAD 330499-00-0601, "Bonded fasteners for use in concrete".

## **4 Assessment and verification of constancy of performance (AVCP)**

### **4.1 AVCP system**

According to the decision 96/582/EC of the European Commission, the system(s) of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) is 1.

## **5 Technical details necessary for the implementation of the AVCP system, as foreseen in the applicable EAD**

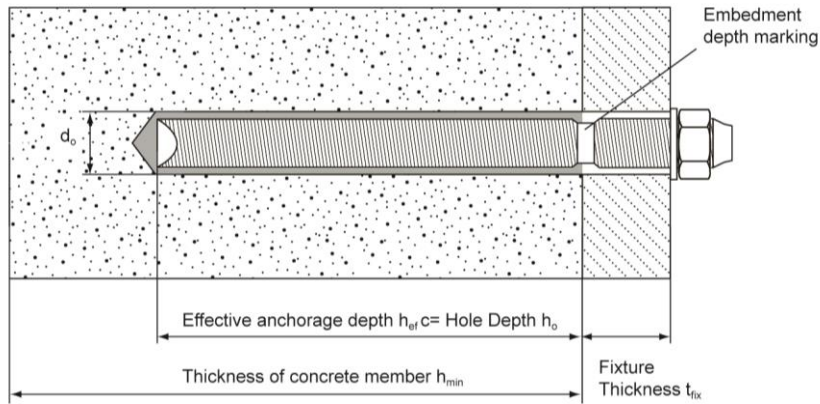
Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at ETA-Danmark prior to CE marking

Issued in Copenhagen on 2020-10-30 by




Thomas Bruun  
Managing Director, ETA-Danmark

**Installation threaded rod M8 up to M24**



**Installation reinforcing bar  $\varnothing 8$  up to  $\varnothing 25$**

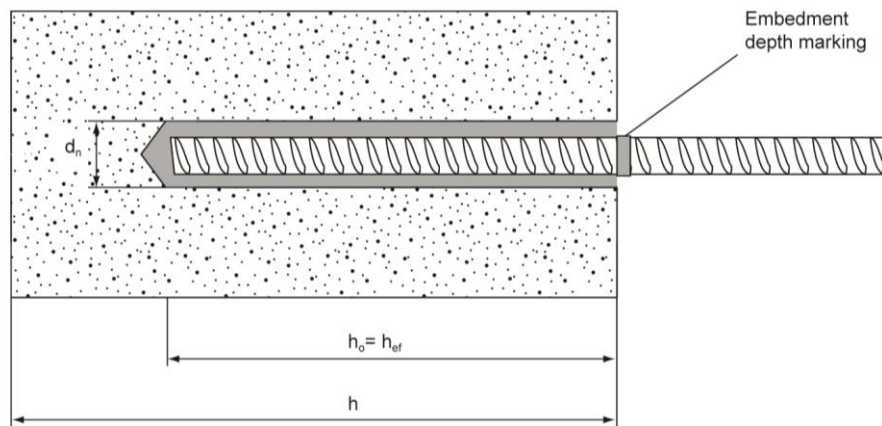


- $t_{fix}$  = thickness of fixture
- $h_{ef}$  = effective anchorage depth
- $h_o$  = depth of drill hole
- $h_{min}$  = minimum thickness of member

**Chemfix 100 and Chemfix 600 Injection System for concrete**

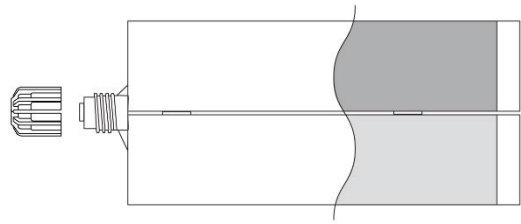
**Product description**  
Installed condition

**Annex A1**

**Chemfix 100 Injection System  
Side by Side Cartridge 1:1 ratio  
400ml / 600ml / 1500 ml**



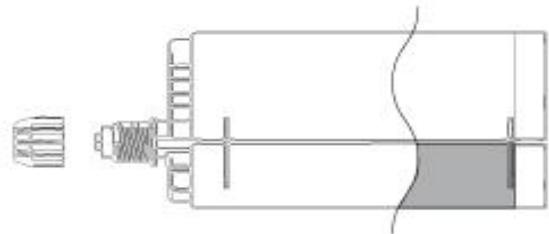**Chemfix 600 Injection System  
Side by Side Cartridge 3:1 ratio  
385ml / 585ml / 1400ml**



**Chemfix 100 and Chemfix 600 Injection system  
Cartridge  
250ml / 280ml / 300ml**



Cartridge Print: Chemfix 100 or Chemfix 600  
Including - Installation procedure, Production Batch code, Expiry Date,  
Storage conditions, Health & Safety warning, Gel & Cure time according to  
temperatures.


**Chemfix 100 and Chemfix 600 Injection System for concrete**

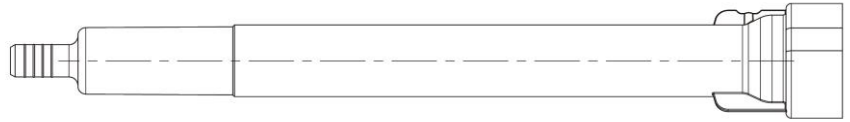**Product description**  
Injection system


**Annex A2**

**Static Mixer**

Mixer



Epoxy mixer



**Mixer Extension**

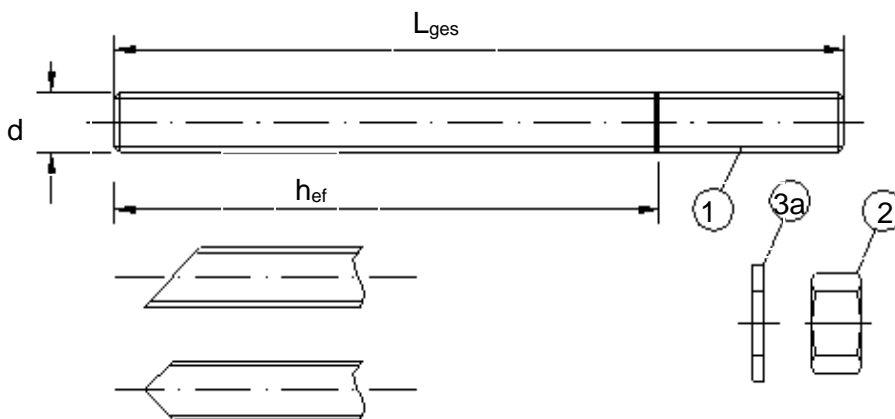
Mixer Extension Short



Mixer Extension Long



**Threaded rod M8, M10, M12, M16, M20, M24, with washer and hexagon nut**



- Commercial standard threaded rod with:
- Materials, dimensions and mechanical properties acc. Table A1
  - Inspection certificate 3.1 acc. to EN 10204:2004
  - Marking of embedment depth

**Chemfix 100 and Chemfix 600 Injection System for concrete**

**Annex A3**

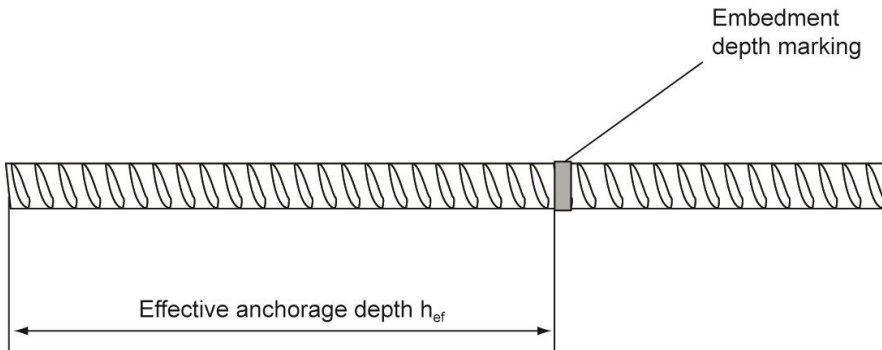
**Product description**

Mixers, extensions and Threaded rod



<b>Table A1: Materials</b>				
<b>Designation</b>		<b>Material</b>		
<b>Steel, zinc plated ( Steel acc. to EN 10087:1998 or EN 10263:2001)</b>				
zinc plated $\geq 5 \mu\text{m}$ acc. to EN ISO 4042:1999 or hot-dip galvanized $\geq 40 \mu\text{m}$ acc. to EN ISO 1461:2009 and EN ISO 10684:2004+AC:2009 or sherardized $\geq 40 \mu\text{m}$ acc. to DIN EN 17668:2016-06				
1	Anchor rod	Property class acc. to EN ISO 898-1:2013	4.6	$f_{uk}=400 \text{ N/mm}^2$ ; $f_{yk}=240 \text{ N/mm}^2$ ; $A_5 > 8\%^{(4)}$ fracture elongation
			4.8	$f_{uk}=400 \text{ N/mm}^2$ ; $f_{yk}=320 \text{ N/mm}^2$ ; $A_5 > 8\%^{(4)}$ fracture elongation
			5.6	$f_{uk}=500 \text{ N/mm}^2$ ; $f_{yk}=300 \text{ N/mm}^2$ ; $A_5 > 8\%^{(4)}$ fracture elongation
			5.8	$f_{uk}=500 \text{ N/mm}^2$ ; $f_{yk}=400 \text{ N/mm}^2$ ; $A_5 > 8\%^{(4)}$ fracture elongation
			8.8	$f_{uk}=800 \text{ N/mm}^2$ ; $f_{yk}=640 \text{ N/mm}^2$ ; $A_5 > 8\%^{(4)}$ fracture elongation
			10.9	$f_{uk}=1000 \text{ N/mm}^2$ ; $f_{yk}=900 \text{ N/mm}^2$ ; $A_5 > 8\%^{(4)}$ fracture elongation
			12.9	$f_{uk}=1200 \text{ N/mm}^2$ ; $f_{yk}=900 \text{ N/mm}^2$ ; $A_5 > 8\%^{(4)}$ fracture elongation
2	Hexagon nut	Property class acc. to EN ISO 898-2:2012	4	for anchor rod class 4.6 or 4.8
			5	for anchor rod class 5.6 or 5.8
			8	for anchor rod class 8.8
			10	for anchor rod class 10.9
			12	for anchor rod class 12.9
3a	Washer, (z.B.: EN ISO 887:2006, EN ISO 7089:2000, EN ISO 7093:2000 oder EN ISO 7094:2000)	Steel, zinc plated, hot-dip galvanized or sherardized		
<b>Stainless steel A2 ( Material 1.4301 / 1.4303 / 1.4307 / 1.4567 and 1.4541, acc. to EN 10088-1:2014)</b>				
<b>and Stainless steel A4 ( Material 1.4401 / 1.4404 / 1.4571 / 1.4362 or 1.4578, acc. to EN 10088-1:2014)</b>				
1	Anchor rod <sup>1)2)</sup>	Property class acc. to EN ISO 3506-1:2009	50	$f_{uk}=500 \text{ N/mm}^2$ ; $f_{yk}=210 \text{ N/mm}^2$ ; $A_5 > 8\%^{(4)}$ fracture elongation
			70	$f_{uk}=700 \text{ N/mm}^2$ ; $f_{yk}=450 \text{ N/mm}^2$ ; $A_5 > 8\%^{(4)}$ fracture elongation
			80	$f_{uk}=800 \text{ N/mm}^2$ ; $f_{yk}=600 \text{ N/mm}^2$ ; $A_5 > 8\%^{(4)}$ fracture elongation
2	Hexagon nut <sup>1)2)</sup>	Property class acc. to EN ISO 3506-1:2009	50	for anchor rod class 50
			70	for anchor rod class 70
			80	for anchor rod class 80
3a	Washer, (z.B.: EN ISO 887:2006, EN ISO 7089:2000, EN ISO 7093:2000 oder EN ISO 7094:2000)	A2: Material 1.4301 / 1.4303 / 1.4307 / 1.4567 or 1.4541, EN 10088-1:2014 A4: Material 1.4401 / 1.4404 / 1.4571 / 1.4362 or 1.4578, EN 10088-1:2014		
<b>High corrosion resistance steel ( Material 1.4529 or 1.4565, acc. to EN 10088-1: 2014)</b>				
1	Anchor rod <sup>1)</sup>	Property class acc. to EN ISO 3506-1:2009	50	$f_{uk}=500 \text{ N/mm}^2$ ; $f_{yk}=210 \text{ N/mm}^2$ ; $A_5 > 8\%^{(4)}$ fracture elongation
			70	$f_{uk}=700 \text{ N/mm}^2$ ; $f_{yk}=450 \text{ N/mm}^2$ ; $A_5 > 8\%^{(4)}$ fracture elongation
			80	$f_{uk}=800 \text{ N/mm}^2$ ; $f_{yk}=600 \text{ N/mm}^2$ ; $A_5 > 8\%^{(4)}$ fracture elongation
2	Hexagon nut <sup>1)</sup>	Property class acc. to EN ISO 3506-1:2009	50	for anchor rod class 50
			70	for anchor rod class 70
			80	for anchor rod class 80
3a	Washer, (z.B.: EN ISO 887:2006, EN ISO 7089:2000, EN ISO 7093:2000 oder EN ISO 7094:2000)	Material 1.4529 or 1.4565, acc. to EN 10088-1: 2014		
<sup>1)</sup> Property class 70 for anchor rods up to M24				
<sup>2)</sup> Property class 70 only for stainless steel A4				
<b>Chemfix 100 and Chemfix 600 Injection System for concrete</b>				<b>Annex A4</b>
<b>Product description</b> Materials threaded rod				

**Reinforcing bar  $\varnothing 8, \varnothing 10, \varnothing 12, \varnothing 14, \varnothing 16, \varnothing 20, \varnothing 24, \varnothing 25,$**



- Minimum value of related rip area  $f_{R,min}$  according to EN 1992-1-1:2004+AC:2010
- Rib height of the bar shall be in the range  $0,05d \leq h \leq 0,07d$   
(d: Nominal diameter of the bar; h: Rip height of the bar)

**Table A2: Materials**

Part	Designation	Material
<b>Reinforcing bars</b>		
1	Rebar EN 1992-1-1:2004+AC:2010, Annex C	Rebar class B or C $f_{yk}$ and k according to NDP or NCL of EN 1992-1-1/NA:2013 $f_{uk} = f_{tk} = k \cdot f_{yk}$

<b>Chemfix 100 and Chemfix 600 Injection System for concrete</b>	<b>Annex A5</b>
<b>Product description</b> Materials reinforcing bar	

## Specifications of intended use

### Anchorage subject to:

- Static and quasi-static loads: M8 to M24, Rebar Ø8 to Ø25.

### Base materials:

- Reinforced or unreinforced normal weight concrete without fibres according to EN 206:2013.
- Strength classes C20/25 to C50/60 according to EN 206:2013.
- Non-cracked concrete: M8 to M24, Rebar Ø8 to Ø25.
- Cracked concrete: M12 to M24, Rebar Ø12 to Ø25.

### Temperature Range:

- I: - 40 °C to +40 °C (max long term temperature +24 °C and max short term temperature +40 °C)
- II: - 40 °C to +60 °C (max long term temperature +40 °C and max short term temperature +60 °C)

### Use conditions (Environmental conditions):

- Structures subject to dry internal conditions.  
(zinc coated steel, stainless steel A2 resp. A4 or high corrosion resistant steel).
- Structures subject to external atmospheric exposure (including industrial and marine environment) and to permanently damp internal condition, if no particular aggressive conditions exist  
(stainless steel A4 or high corrosion resistant steel).
- Structures subject to external atmospheric exposure and to permanently damp internal condition, if other particular aggressive conditions exist  
(high corrosion resistant steel).

Note: Particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used).

### Design:

- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e. g. position of the anchor relative to reinforcement or to supports, etc.).
- Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete work.
- The Anchorages are designed in accordance to:
  - EN 1992-4:2018
  - Technical Report TR055

### Installation:

- Dry or wet concrete: M8 to M24, Rebar Ø8 to Ø25.
- Flooded holes (not sea water): M8 to M24, Rebar Ø8 to Ø25.
- Hole drilling by hammer (HD) or compressed air drill mode (CD) used in Category 1 (dry and wet concrete) and Category 2 (flooded holes)
- Hole drilling by hollow drill bits for dust free drilling (HDB) (e.g. Bosch self-cleaning system including vacuum cleaner) used in Category 1 – dry and wet concrete
- Hole drilling by diamond coring method (DD) used in Category 1 (dry and wet concrete) and Category 2 (flooded holes)
- Overhead installation allowed.
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.

<b>Chemfix 100 and Chemfix 600 Injection System for concrete</b>	<b>Annex B1</b>
<b>Intended Use</b> Specifications	

**Table B1: Installation parameters for threaded rod**

Anchor size		M 8	M 10	M 12	M 16	M 20	M 24
Outer diameter of anchor	$d_{nom}$ [mm] =	8	10	12	16	20	24
Nominal drill hole diameter	$d_0$ [mm] =	10	12	14	18	22/24	28
Effective anchorage depth	$h_{ef,min}$ [mm] =	60	60	70	80	90	96
	$h_{ef,max}$ [mm] =	160 (100 for Hollow Drilling)		200	240	320	400
Diameter of clearance hole in the fixture	$d_f$ [mm] ≤	9	12	14	18	22	26
Diameter of steel brush	$d_b$ [mm] ≥	10	12	14	18	22/24	28
Maximum torque moment	$T_{inst}$ [Nm] ≤	10	15	40	60	120	160
Minimum thickness of member	$h_{min}$ [mm]	$h_{ef} + 30 \text{ mm} \geq 100 \text{ mm}$			$h_{ef} + 2d_0$		
Minimum spacing	$s_{min}$ [mm]	40	40	60	80	100	120
Minimum edge distance	$c_{min}$ [mm]	40	40	60	80	100	120

**Table B2: Installation parameters for rebar**

Rebar size		Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 25
Outer diameter of anchor	$d_{nom}$ [mm] =	8	10	12	14	16	20	25
Nominal drill hole diameter	$d_0$ [mm] =	12	14	16	18	20	22/24	32
Effective anchorage depth	$h_{ef,min}$ [mm] =	60	60	70	75	80	90	100
	$h_{ef,max}$ [mm] =	160	200	240	280	320	400	500
Diameter of steel brush	$d_b$ [mm] ≥	12	14	16	18	20	24	32
Minimum thickness of member	$h_{min}$ [mm]	$h_{ef} + 30 \text{ mm} \geq 100 \text{ mm}$		$h_{ef} + 2d_0$				
Minimum spacing	$s_{min}$ [mm]	40	40	60	60	80	100	120
Minimum edge distance	$c_{min}$ [mm]	40	40	60	60	80	100	120

**Chemfix 100 and Chemfix 600 Injection System for concrete**

**Intended Use**  
Installation parameters

**Annex B2**

**Table B3: Parameter cleaning and setting tools**

				
<b>Threaded Rod</b>	<b>Rebar</b>	<b>d<sub>0</sub></b> <b>Drill bit - Ø</b> HD, CD, HDB, Diamond	<b>d<sub>b</sub></b> <b>Brush - Ø</b>	<b>d<sub>b,min</sub></b> <b>min.</b> <b>Brush - Ø</b>
<b>(mm)</b>	<b>(mm)</b>	<b>(mm)</b>	<b>(mm)</b>	<b>(mm)</b>
8		10	10	10
M10	8	12	12	12
M12	10	14	14	14
	12	16	16	16
M16	14	18	18	18
	16	20	20	20
M20	20	22 or 24	22 or 24	22 or 24
M24		28	28	28
	25	32	32	32



**Push Pump**

Drill bit diameter (d<sub>0</sub>): 10 mm to 20 mm  
 Drill hole depth (h<sub>0</sub>): < 10 d<sub>nom</sub>  
 Only in non-cracked concrete



**CAC - Compressed air tool (min 6 bar)**

Drill bit diameter (d<sub>0</sub>): all diameters



**Bosch® Hollow Drilling and Vacuum**



**Steel Brush**







Drill bit diameter (d<sub>0</sub>): all diameters

**Chemfix 100 and Chemfix 600 Injection System for concrete**

**Annex B3**

**Intended Use**

Cleaning and setting tools




Instructions for use – Hammer drilling (HD) and Compressed air drilling (CD)		
<b>Bore hole drilling</b>		
		Drill hole to the required embedment depth with a hammer drill set in rotation-hammer mode using an appropriately sized carbide drill bit.(see table B3)
<b>Bore hole cleaning</b> Just before setting an anchor, the bore hole must be free of dust and debris.		
<b>a) Manual air cleaning (MAC) for bore hole diameters <math>d_o \leq 18\text{mm}</math> and bore hole depth <math>h_o \leq 10d</math></b>		
	<b>X 2</b>	The Chemfix manual pump may be used for blowing out bore holes up to diameters $d_o \leq 20\text{mm}$ and embedment depths up to $h_{ef} \leq 10d$ .  Blow out at least 2 times from the back of the bore hole until return air stream is free of noticeable dust.
	<b>X 2</b>	Brush 2 times with the specified brush size (brush $\varnothing \geq$ bore hole $\varnothing$ , see Table B3) by inserting the steel brush to the back of the hole (if needed with an extension) in a twisting motion and removing it. The brush must produce natural resistance as it enters the bore hole. If not, the brush is too small and must be replaced with the proper brush diameter.
	<b>X 2</b>	Blow out again with manual pump at least 2 times until return air stream is free from noticeable dust.
	<b>X 2</b>	Brush 2 times again by inserting the Chemfix steel brush to the back of the hole (if needed with an extension) in a twisting motion and removing it. The brush must produce natural resistance as it enters the bore hole. If not, the brush is too small and must be replaced with the proper brush diameter.
	<b>X 2</b>	Blow out again with manual pump at least 2 times until return air stream is free from noticeable dust.

**Chemfix 100 and Chemfix 600 Injection System for concrete**


**Annex B4**

**Intended Use**



Installation instructions –hammer drilling and compressed air drilling

<b>b) Compressed air cleaning (CAC) for all bore hole diameters <math>d_o</math> and all bore hole depth <math>h_o</math></b>		
	<b>X 2</b>	Blow 2 times from the back of the hole (if needed with a nozzle extension) over the hole length with oil-free compressed air (min. 6 bar at 6m <sup>3</sup> /h) until return air stream is free from noticeable dust.
	<b>X 2</b>	Brush 2 times with the specified brush size (brush $\varnothing \geq$ bore hole $\varnothing$ , see Table B3) by inserting the steel brush to the back of the hole (if needed with an extension) in a twisting motion and removing it. The brush must produce natural resistance as it enters the bore hole. If not, the brush is too small and must be replaced with the proper brush diameter.
	<b>X 2</b>	Blow out again with compressed air at least 2 times until return air stream is free from noticeable dust.

**Instructions for use – Hollow drill bits for dust free drilling (HDB)**

<b>Bore hole drilling and cleaning</b>		
		Select a suitable hollow drill bit (see table B3) and install it into the hammer drilling machine. Connect the dust extraction system to the aperture in the hollow drill bit. (e.g: Bosch system) Drill hole to the required embedment depth with the hammer drill set in rotation-hammer mode and with the dust extraction system working permanently at full power.
<b>Bore hole cleaning:</b> Manual cleaning is not necessary when using the self-cleaning drilling method.		

**Instructions for use – Diamond drilling (DD) -wet drilling with diamond drill bits**






<b>Bore hole drilling</b>		
		Drill with a diamond drills a hole into the base material to size and embedment depth required by the selected anchor (see table B3)
<b>Bore hole cleaning</b> Just before setting an anchor, the bore hole must be free of dust and debris.		
		Rinsing with water until clean water comes out.

**Chemfix 100 and Chemfix 600 Injection System for concrete**

**Intended Use**

Installation instructions – hammer drilling, compressed air drilling, hollow drill bits drilling and diamond drilling

**Annex B5**

	<p><b>X 2</b></p>	<p>Brush 2 times with the specified brush size (brush <math>\varnothing \geq</math> bore hole <math>\varnothing</math>, see Table B3) by inserting the Chemfix steel brush to the back of the hole (if needed with an extension) in a twisting motion and removing it. The brush must produce natural resistance as it enters the bore hole. If not, the brush is too small and must be replaced with the proper brush diameter.</p>
		<p>Rinsing with water until clean water comes out. <b>ATTENTION! STANDING WATER IN THE BORE HOLE MUST BE REMOVED BEFORE CLEANING</b></p>
	<p><b>X 2</b></p>	<p>Starting from the bottom or back hole, blow the hole clean with compressed air (min 6 bar at 6m<sup>3</sup>/h) a minimum of 2 times until return air stream is free from noticeable dust or concrete particle. If the bore hole ground is not reached an extension shall be used.</p>
	<p><b>X 2</b></p>	<p>Brush 2 times with the specified brush size (brush <math>\varnothing \geq</math> bore hole <math>\varnothing</math>, see Table B3) by inserting the Chemfix steel brush to the back of the hole (if needed with an extension) in a twisting motion and removing it. The brush must produce natural resistance as it enters the bore hole. If not, the brush is too small and must be replaced with the proper brush diameter.</p>
	<p><b>X 2</b></p>	<p>Finally, blow the hole clean again with compressed air (min 6 bar at 6m<sup>3</sup>/h) a minimum of 2 times until return air stream is free from noticeable dust or concrete particle. If the bore hole ground is not reached an extension shall be used. After cleaning, the bore hole has to be protected against re-contamination in an appropriate way, until dispensing the mortar in the bore hole. <b>If necessary, the cleaning has to be repeated directly before dispensing the mortar. In-flowing water must not contaminate the bore hole again.</b></p>








**Chemfix 100 and Chemfix 600 Injection System for concrete**

**Intended Use**

Installation instructions – diamond drilling

**Annex B6**



Instructions for use – all types of drilling	
	Remove the threaded cap from the cartridge.
	Attach the supplied mixing nozzle to the cartridge and load the cartridge into the correct dispensing tool. Cut off the foil tube clip before use if necessary. For every working interruption longer than the recommended working time (Table B4) as well as for new cartridges, a new mixer shall be used. After changing the mixer, discard the waste until the mortar shows a consistent colour.
	Insert the cartridge into the dispenser. Press the release trigger to retract the plunger and insert the cartridge neatly into the cradle without any distortion. Prior to inserting the anchor rod into the filled bore hole, the position of the embedment depth shall be marked on the anchor rods.
	Prior to dispensing into the anchor hole, squeeze out separately a minimum of three full strokes and discard non-uniformly mixed adhesive components until the mortar shows a consistent colour. For foil tube cartridges it must be discarded a minimum of six full strokes. If you interrupt the job and restart using the same mixer inside the working time frame, discard the waste until the mortar shows a consistent colour.
	Starting from the bottom or back of the cleaned anchor hole, fill the hole up to approximately two-thirds with adhesive. Slowly withdraw the mixing nozzle as the hole fills to avoid creating air pockets. If needed, an extension nozzle shall be used. Observe the gel-/ working times given in Table B4.
	Push the threaded rod or reinforcing bar into the anchor hole while turning slightly to ensure positive distribution of the adhesive until the embedment depth is reached.  The anchor shall be free of dirt, grease, oil or other foreign material.  Be sure that the anchor is fully seated at the bottom of the hole and that excess mortar is visible at the top of the hole. If these requirements are not maintained, the application has to be renewed. For overhead application the anchor rod shall be fixed (e.g. wedges).
	Allow the adhesive to cure to the specified time prior to applying any load or torque. Do not move or load the anchor until it is fully cured (attend Table B4). After full curing, the add-on part can be installed with up to the max. torque (Table B1) by using a calibrated torque wrench. It can be optionally filled the annular gap between anchor and fixture with mortar.

**Chemfix 100 and Chemfix 600 Injection System for concrete**

**Intended Use**

Installation instructions – resin injection and bar insertion





**Annex B7**

**Table B4: Maximum Working time and minimum curing time  
Chemfix 100 and Chemfix 600**

Concrete temperature	Gelling- / working time	Minimum curing time in dry concrete <sup>1)</sup>
+ 5 °C	70 min	60 h
+ 10 °C	32 min	40 h
+ 15 °C	28 min	30 h
+ 20 °C	25 min	18 h
+ 25 °C	22 min	17 h
+ 30 °C	20 min	16 h
+ 40 °C	18 min	12 h
Cartridge temperature	+ 15 °C to + 35 °C	

<sup>1)</sup> In wet concrete the curing time must be doubled.

**Table B5: Dispensing tools**

Resin injection pump details		
Image	Size Cartridge	Type
	400 ml 1:1 600 ml 1:1 385 / 585 ml 3:1  250 / 280 / 300 ml	Manual
	400 ml 1:1 600 ml 1:1 385 / 585 ml 3:1  250 / 280 / 300 ml  7.4v Tool	Battery
	400 ml 1:1 600 ml 1:1 385 / 585 ml 3:1  250 / 280 / 300 ml	Pneumatic
	1400 ml 3:1 1500 ml 1:1	Pneumatic

**Chemfix 100 and Chemfix 600 Injection System for concrete**

**Annex B8**

**Intended Use**

Curing time and Dispensing tools

**Table C1: Characteristic values for steel tension resistance and steel shear resistance of threaded rods**

Size			M 8	M 10	M 12	M 16	M 20	M 24	
<b>Characteristic tension resistance, Steel failure</b>									
Steel, Property class 4.6 and 4.8	$N_{Rk,s}$	[kN]	15	23	34	63	98	141	
Steel, Property class 5.6 and 5.8	$N_{Rk,s}$	[kN]	18	29	42	78	122	176	
Steel, Property class 8.8	$N_{Rk,s}$	[kN]	29	46	67	125	196	282	
Steel, Property class 10.9	$N_{Rk,s}$	[kN]	37	58	84	157	245	353	
Steel, Property class 12.9	$N_{Rk,s}$	[kN]	44	70	101	188	294	424	
Stainless steel A2, A4 and HCR, Property class 50	$N_{Rk,s}$	[kN]	18	29	42	79	123	177	
Stainless steel A2, A4 and HCR, Property class 70	$N_{Rk,s}$	[kN]	26	41	59	110	171	247	
Stainless steel A4 and HCR, Property class 80	$N_{Rk,s}$	[kN]	29	46	67	126	196	282	
<b>Characteristic tension resistance, Partial factor</b>									
Steel, Property class 4.6 and 5.6	$\gamma_{Ms,N}^{1)}$	[-]	2,0						
Steel, Property class 4.8, 5.8 and 8.8	$\gamma_{Ms,N}^{1)}$	[-]	1,5						
Steel, Property class 10.9 and 12.9	$\gamma_{Ms,N}^{1)}$	[-]	1,4						
Stainless steel A2, A4 and HCR, Property class 50	$\gamma_{Ms,N}^{1)}$	[-]	2,86						
Stainless steel A2, A4 and HCR, Property class 70	$\gamma_{Ms,N}^{1)}$	[-]	1,87						
Stainless steel A4 and HCR, Property class 80	$\gamma_{Ms,N}^{1)}$	[-]	1,6						
<b>Characteristic shear resistance, Steel failure</b>									
Without lever arm	Steel, Property class 4.6 and 4.8	$V_{Rk,s}^0$	[kN]	7	12	17	31	49	71
	Steel, Property class 5.6 and 5.8	$V_{Rk,s}^0$	[kN]	9	15	21	39	61	88
	Steel, Property class 8.8	$V_{Rk,s}^0$	[kN]	15	23	34	63	98	141
	Steel, Property class 10.9	$V_{Rk,s}^0$	[kN]	18	29	42	79	123	177
	Steel, Property class 12.9	$V_{Rk,s}^0$	[kN]	22	35	51	94	147	212
	Stainless steel A2, A4 and HCR, Property class 50	$V_{Rk,s}^0$	[kN]	9	15	21	39	61	88
	Stainless steel A2, A4 and HCR, Property class 70	$V_{Rk,s}^0$	[kN]	13	20	30	55	86	124
	Stainless steel A4 and HCR, Property class 80	$V_{Rk,s}^0$	[kN]	15	23	34	63	98	141
With lever arm	Steel, Property class 4.6 and 4.8	$M_{Rk,s}^0$	[Nm]	15	30	52	133	260	449
	Steel, Property class 5.6 and 5.8	$M_{Rk,s}^0$	[Nm]	19	37	65	166	324	560
	Steel, Property class 8.8	$M_{Rk,s}^0$	[Nm]	30	60	105	266	519	896
	Steel, Property class 10.9	$M_{Rk,s}^0$	[Nm]	37	75	131	333	649	1123
	Steel, Property class 12.9	$M_{Rk,s}^0$	[Nm]	45	90	157	400	778	1347
	Stainless steel A2, A4 and HCR, Property class 50	$M_{Rk,s}^0$	[Nm]	19	37	66	167	325	561
	Stainless steel A2, A4 and HCR, Property class 70	$M_{Rk,s}^0$	[Nm]	26	52	92	232	454	784
	Stainless steel A4 and HCR, Property class 80	$M_{Rk,s}^0$	[Nm]	30	59	105	266	519	896
<b>Characteristic shear resistance, Partial factor</b>									
Steel, Property class 4.6 and 5.6	$\gamma_{Ms,V}^{1)}$	[-]	1,67						
Steel, Property class 4.8, 5.8 and 8.8	$\gamma_{Ms,V}^{1)}$	[-]	1,25						
Steel, Property class 10.9 and 12.9	$\gamma_{Ms,V}^{1)}$	[-]	1,50						
Stainless steel A2, A4 and HCR, Property class 50	$\gamma_{Ms,V}^{1)}$	[-]	2,38						
Stainless steel A2, A4 and HCR, Property class 70	$\gamma_{Ms,V}^{1)}$	[-]	1,56						
Stainless steel A4 and HCR, Property class 80	$\gamma_{Ms,V}^{1)}$	[-]	1,33						

<sup>1)</sup> in absence of national regulation

**Chemfix 100 and Chemfix 600 Injection System for concrete**

**Performances**

Characteristic values for steel tension resistance and steel shear resistance of threaded rods

**Annex C1**

**Table C2: Characteristic values of tension loads under static and quasi-static action for non-cracked and cracked concrete for threaded bars.**

Anchor size threaded rod				M 8	M 10	M 12	M 16	M 20	M 24
<b>Steel failure</b>									
Characteristic tension resistance		$N_{Rk,s}$	[kN]	see Table C1					
Partial factor		$\gamma_{Ms,N}$	[-]	see Table C1					
<b>Combined pull-out and concrete failure</b>									
<b>Characteristic bond resistance in non-cracked concrete C20/25 hammer drilling (HD) and compressed air drilling (CD)</b>									
Temperature range I: 40°C/24°C	dry and wet concrete	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	9	10	16	15	15	15
	flooded bore hole	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	9	10	16	15	15	15
Temperature range II: 60°C/40°C	dry and wet concrete	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	8	9	14	14	14	14
	flooded bore hole	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	8	9	14	14	14	14
<b>Characteristic bond resistance in cracked concrete C20/25 hammer drilling (HD) and compressed air drilling (CD)</b>									
Temperature range I: 40°C/24°C	dry and wet concrete	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	-	-	7	7,5	8	8
	flooded bore hole	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	-	-	7	7,5	8	8
Temperature range II: 60°C/40°C	dry and wet concrete	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	-	-	6,5	7	7	7,5
	flooded bore hole	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	-	-	6,5	7	7	7,5
Installation factor for HD and CD in dry and wet concrete (for T I and T II):		$\gamma_{inst}^{(1)}$	[-]	1,4			1,2		
Installation factor for HD and CD in flooded bore hole (for T I and T II):		$\gamma_{inst}^{(1)}$	[-]	1,4					
<b>Characteristic bond resistance in non-cracked concrete C20/25 hollow drill bits for dust free drilling (HDB)</b>									
Temperature range I: 40°C/24°C	dry and wet concrete	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	16	16	16	15	15	14
Temperature range II: 60°C/40°C	dry and wet concrete	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	15	15	14	14	14	13
<b>Characteristic bond resistance in cracked concrete C20/25 hollow drill bits for dust free drilling (HDB)</b>									
Temperature range I: 40°C/24°C	dry and wet concrete	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	-	-	7	7,5	8	8
Temperature range II: 60°C/40°C	dry and wet concrete	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	-	-	6,5	7	7	7,5
Installation factor for HDB in dry and wet concrete (for T I and T II):		$\gamma_{inst}^{(1)}$	[-]	1,0		1,2		1,4	
<b>Characteristic bond resistance in non-cracked concrete C20/25 Diamond drilling (DD)</b>									
Temperature range I: 40°C/24°C	dry and wet concrete	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	15	14	13	12	11	11
	flooded bore hole	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	15	14	13	12	11	11
Temperature range II: 60°C/40°C	dry and wet concrete	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	14	13	12	11	11	10
	flooded bore hole	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	14	13	12	11	11	10
<b>Characteristic bond resistance in cracked concrete C20/25 Diamond drilling (DD)</b>									
Temperature range I: 40°C/24°C	dry and wet concrete	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	-	-	5	5	4	3,5
	flooded bore hole	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	-	-	5	5	4	3,5
Temperature range II: 60°C/40°C	dry and wet concrete	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	-	-	4,5	4,5	4	3
	flooded bore hole	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	-	-	4,5	4,5	4	3
Installation factor for DD (dry and wet concrete)		$\gamma_{inst}^{(1)}$	[-]	1,0		1,2			
Installation factor for DD (flooded bore hole)		$\gamma_{inst}^{(1)}$	[-]	1,2			1,4		
Increasing factors for concrete (for all type of drilling in cracked and non-cracked concrete) in any temperature range $\psi_c$		C25/30		1,05					
		C30/37		1,10					
		C35/45		1,15					
		C40/50		1,18					
		C45/55		1,20					
		C50/60		1,23					

**Chemfix 100 and Chemfix 600 Injection System for concrete****Annex C2****Performances**

Characteristic values of tension loads under static and quasi-static action

**Table C2: continuation**

<b>Concrete cone failure (all drilling methods) in any temperature range</b>				
Non-cracked concrete	$k_{ucr,N}$	[-]	11,0	
Cracked concrete	$k_{cr,N}$	[-]	7,7	
Edge distance	$c_{cr,N}$	[mm]	1,5 $h_{ef}$	
Axial distance	$s_{cr,N}$	[mm]	2 $c_{cr,N}$	
<b>Splitting (all drilling methods)</b>				
Edge distance	$h/h_{ef} \geq 2,0$	$c_{cr,sp}$	[mm]	1,0 $h_{ef}$
	$2,0 > h/h_{ef} > 1,3$			3,86 $h_{ef}$ - 1,43 $h$
	$h/h_{ef} \leq 1,3$			2 $h_{ef}$
Axial distance	$s_{cr,sp}$	[mm]	2 $c_{cr,sp}$	

<sup>1)</sup> in the absence of national regulation

**Table C3: Characteristic values of shear loads under static and quasi-static action for threaded bars, all drilling methods**

Anchor size threaded rod		M 8	M 10	M 12	M 16	M 20	M 24	
<b>Steel failure without lever arm</b>								
Characteristic shear resistance	$V_{Rk,s}^0$	[kN]	see Table C1					
Partial factor	$\gamma_{Ms,V}$	[-]	see Table C1					
Ductility factor	$k_{\gamma}$	[-]	1,0					
<b>Steel failure with lever arm</b>								
Characteristic bending moment	$M_{Rk,s}^0$	[Nm]	see Table C1					
Partial factor	$\gamma_{Ms,V}$	[-]	see Table C1					
<b>Concrete pry-out failure</b>								
Factor	$k_{\phi}$	[-]	2,0					
Installation factor	$\gamma_{inst}$	[-]	1,0					
<b>Concrete edge failure</b>								
Effective length of fastener	$l_f$	[mm]	$l_f = \min(h_{ef}; 12 d_{nom})$					
Outside diameter of fastener	$d_{nom}$	[mm]	8	10	12	16	20	24
Installation factor	$\gamma_{inst}$	[-]	1,0					

**Chemfix 100 and Chemfix 600 Injection System for concrete****Performances**

Characteristic values of tension loads under static and quasi-static action and  
Characteristic values of shear loads under static and quasi-static action

**Annex C3**

**Table C4: Characteristic values of tension loads under static and quasi-static action for rebar**

Anchor size reinforcing bar			Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 25	
<b>Steel failure</b>										
Characteristic tension resistance		$N_{Rk,s}$	[kN]	$A_s \cdot f_{uk}^{1)}$						
Cross section area		$A_s$	[mm <sup>2</sup> ]	50	79	113	154	201	314	491
Partial factor		$\gamma_{Ms,N}$	[-]	1,4 <sup>2)</sup>						
<b>Combined pull-out and concrete failure</b>										
<b>Characteristic bond resistance in non-cracked concrete C20/25 for hammer drilling ( HD) and compressed air drilling (CAD)</b>										
Temperature range I: 40°C/24°C	dry and wet concrete	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	10	11	12	12	12	12	12
	flooded bore hole	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	10	11	12	12	12	12	12
Temperature range II: 60°C/40°C	dry and wet concrete	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	9	10	11	11	11	11	11
	flooded bore hole	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	9	10	11	11	11	11	11
<b>Characteristic bond resistance in cracked concrete C20/25 for hammer drilling ( HD) and compressed air drilling (CAD)</b>										
Temperature range I: 40°C/24°C	dry and wet concrete	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	-	-	6,5	6,5	6,5	6,5	6,5
	flooded bore hole	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	-	-	6,5	6,5	6,5	6,5	6,5
Temperature range II: 60°C/40°C	dry and wet concrete	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	-	-	6	6	6	6	6
	flooded bore hole	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	-	-	6	6	6	6	6
Installation factor (dry and wet concrete)		$\gamma_{inst}^{2)}$	[-]	1,4				1,2		
Installation factor (flooded bore hole)		$\gamma_{inst}^{2)}$	[-]	1,4						
<b>Characteristic bond resistance in non-cracked concrete C20/25 for hollow drill bits for dust free system (HDB)</b>										
Temperature range I: 40°C/24°C	dry and wet concrete	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	16	15	14	13	13	12	11
	dry and wet concrete	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	15	14	13	12	12	11	10
<b>Characteristic bond resistance in cracked concrete C20/25 for hollow drill bits for dust free system (HDB)</b>										
Temperature range I: 40°C/24°C	dry and wet concrete	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	-	-	6,5	6,5	6,5	6,5	5,5
	dry and wet concrete	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	-	-	6	6	6	6	5
Installation factor (dry and wet concrete)		$\gamma_{inst}^{2)}$	[-]	1,0			1,2		1,4	
<b>Characteristic bond resistance in non-cracked concrete C20/25 for Diamond drilling (DD)</b>										
Temperature range I: 40°C/24°C	dry and wet concrete	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	11	11	11	11	11	11	10
	flooded bore hole	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	11	11	11	11	11	11	10
Temperature range II: 60°C/40°C	dry and wet concrete	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	10	10	10	10	10	10	9,5
	flooded bore hole	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	10	10	10	10	10	10	9,5
<b>Characteristic bond resistance in cracked concrete C20/25 for Diamond drilling (DD)</b>										
Temperature range I: 40°C/24°C	dry and wet concrete	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	-	-	6	6	6,5	6	5,5
	flooded bore hole	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	-	-	6	6	6,5	6	5,5
Temperature range II: 60°C/40°C	dry and wet concrete	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	-	-	5,5	5,5	6	5,5	5
	flooded bore hole	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	-	-	5,5	5,5	6	5,5	5
Installation factor (dry and wet concrete)		$\gamma_{inst}^{2)}$	[-]	1,0	1,2					
Installation factor (flooded bore hole)		$\gamma_{inst}^{2)}$	[-]	1,2			1,4			

<sup>1)</sup>  $f_{uk}$  shall be taken from the specifications of reinforcing bars

<sup>2)</sup> in absence of national regulation

### Chemfix 100 and Chemfix 600 Injection System for concrete

#### Performances

Characteristic values of tension loads under static and quasi-static action

## Annex C4

**Table C4: continuation**

Anchor size reinforcing bar		Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 25
Increasing factors for non-cracked concrete (all type of drilling) $\psi_c$	C25/30	1,04						
	C30/37	1,08						
	C35/45	1,11						
	C40/50	1,15						
	C45/55	1,18						
	C50/60	1,21						
Increasing factors for cracked concrete (all type of drilling) $\psi_c$	C25/30	1,0	1,0	1,08	1,08	1,08	1,08	1,11
	C30/37	1,0	1,0	1,17	1,17	1,17	1,17	1,22
	C35/45	1,0	1,0	1,24	1,24	1,24	1,24	1,31
	C40/50	1,0	1,0	1,32	1,32	1,32	1,32	1,41
	C45/55	1,0	1,0	1,37	1,37	1,37	1,37	1,48
	C50/60	1,0	1,0	1,42	1,42	1,42	1,42	1,55
<b>Concrete cone failure</b>								
Non-cracked concrete	$k_{ucr,N}$	[-]		11,0				
Cracked concrete	$k_{cr,N}$	[-]		7,7				
Edge distance	$C_{cr,N}$	[mm]		1,5 $h_{ef}$				
Axial distance	$S_{cr,N}$	[mm]		2 $C_{cr,N}$				
<b>Splitting</b>								
Edge distance	$h/h_{ef} \geq 2,0$	$C_{cr,sp}$	[mm]	1,0 $h_{ef}$				
	$2,0 > h/h_{ef} > 1,3$			3,86 $h_{ef} - 1,43 h$				
	$h/h_{ef} \leq 1,3$			2 $h_{ef}$				
Axial distance	$S_{cr,sp}$	[mm]		2 $C_{cr,sp}$				

**Table C5: Characteristic values of shear loads under static and quasi-static action for rebar (all drilling methods)**

Anchor size reinforcing bar		Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 25		
<b>Steel failure without lever arm</b>										
Characteristic shear resistance	$V_{Rk,s}^0$	[kN]		$0,50 \cdot A_s \cdot f_{uk}^{(1)}$						
Cross section area	$A_s$	[mm <sup>2</sup> ]		50	79	113	154	201	314	491
Partial factor	$\gamma_{Ms,V}$	[-]		1,5 <sup>(2)</sup>						
Ductility factor	$k_7$	[-]		1,0						
<b>Steel failure with lever arm</b>										
Characteristic bending moment	$M_{Rk,s}^0$	[Nm]		$1,2 \cdot W_{el} \cdot f_{uk}^{(1)}$						
Elastic section modulus	$W_{el}$	[mm <sup>3</sup> ]		50	98	170	269	402	785	1534
Partial factor	$\gamma_{Ms,V}$	[-]		1,5 <sup>(2)</sup>						
<b>Concrete pry-out failure</b>										
Factor	$k_8$	[-]		2,0						
Installation factor	$\gamma_{inst}$	[-]		1,0						
<b>Concrete edge failure</b>										
Effective length of fastener	$l_f$	[mm]		$l_f = \min(h_{ef}; 12 d_{nom})$						
Outside diameter of fastener	$d_{nom}$	[mm]		8	10	12	14	16	20	25
Installation factor	$\gamma_{inst}$	[-]		1,0						

<sup>1)</sup>  $f_{uk}$  shall be taken from the specifications of reinforcing bars<sup>2)</sup> in absence of national regulation**Chemfix 100 and Chemfix 600 Injection System for concrete****Performances**

Characteristic values of tension loads under static and quasi-static action  
Characteristic values of shear loads under static and quasi-static action

**Annex C5**

**Table C6: Displacements under tension load<sup>1)</sup> (threaded rod)**

Anchor size threaded rod			M 8	M 10	M 12	M 16	M 20	M24
<b>Non-cracked concrete C20/25 Hammer Drilling (HD)</b>								
Temperature range I: 40°C/24°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,06	0,05	0,03	0,07	0,07	0,07
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,09	0,08	0,06	0,11	0,12	0,13
Temperature range II: 60°C/40°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,09	0,07	0,06	0,11	0,11	0,12
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,16	0,13	0,10	0,19	0,19	0,21
<b>Non-cracked concrete C20/25 Hollow Drilling (HDB)</b>								
Temperature range I: 40°C/24°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,03	0,03	0,03	0,06	0,06	0,05
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,06	0,06	0,06	0,11	0,10	0,09
Temperature range II: 60°C/40°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,05	0,05	0,06	0,10	0,09	0,08
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,09	0,09	0,10	0,18	0,16	0,14
<b>Non-cracked concrete C20/25 Diamond Drilling (DD)</b>								
Temperature range I: 40°C/24°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,01	0,01	0,01	0,02	0,03	0,03
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,02	0,02	0,06	0,03	0,04	0,05
Temperature range II: 60°C/40°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,02	0,02	0,02	0,03	0,04	0,05
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,04	0,04	0,04	0,06	0,07	0,09
<b>Cracked concrete C20/25 Hammer Drilling (HD) and Hollow Drilling (HDB)</b>								
Temperature range I: 40°C/24°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	-	0,05	0,07	0,08	0,09	
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	-	0,08	0,09	0,23	0,25	
Temperature range II: 60°C/40°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	-	0,09	0,11	0,13	0,14	
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	-	0,13	0,14	0,37	0,40	
<b>Cracked concrete C20/25 Diamond Drilling (DD)</b>								
Temperature range I: 40°C/24°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	-	0,03	0,04	0,04	0,03	
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	-	0,04	0,05	0,11	0,09	
Temperature range II: 60°C/40°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	-	0,05	0,07	0,06	0,05	
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	-	0,07	0,09	0,18	0,15	

<sup>1)</sup> Calculation of the displacement

$$\delta_{N0} = \delta_{N0}\text{-factor} \cdot \tau; \quad \tau: \text{action bond stress for tension}$$

$$\delta_{N\infty} = \delta_{N\infty}\text{-factor} \cdot \tau;$$

**Chemfix 100 and Chemfix 600 Injection System for concrete**

**Performances**

Displacements under tension load (threaded rods)

**Annex C6**



**Table C7: Displacements under shear load<sup>1)</sup> (threaded rod)**

Anchor size threaded rod			M 8	M 10	M 12	M 16	M 20	M 24
<b>For non-cracked concrete C20/25</b>								
Temperature range I: 40°C/24°C	$\delta_{V0}$ -factor	[mm/(kN)]	0,06	0,06	0,05	0,04	0,04	0,03
	$\delta_{V\infty}$ -factor	[mm/(kN)]	0,09	0,08	0,08	0,06	0,06	0,05
Temperature range II: 60°C/40°C	$\delta_{V0}$ -factor	[mm/(kN)]	0,06	0,06	0,05	0,04	0,04	0,03
	$\delta_{V\infty}$ -factor	[mm/(kN)]	0,09	0,08	0,08	0,06	0,06	0,05
<b>For cracked concrete C20/25</b>								
Temperature range I: 40°C/24°C	$\delta_{N0}$ -factor	[mm/(kN)]	-	0,11	0,10	0,09	0,08	
	$\delta_{N\infty}$ -factor	[mm/(kN)]	-	0,17	0,15	0,14	0,13	
Temperature range II: 60°C/40°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	-	0,11	0,10	0,09	0,08	
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	-	0,17	0,15	0,14	0,13	

<sup>1)</sup> Calculation of the displacement

$$\delta_{V0} = \delta_{V0}\text{-factor} \cdot V; \quad V: \text{action shear load}$$

$$\delta_{V\infty} = \delta_{V\infty}\text{-factor} \cdot V;$$

**Chemfix 100 and Chemfix 600 Injection System for concrete**

**Performances**

Displacements under shear load (threaded rods)

**Annex C7**

**Table C8: Displacements under tension load<sup>1)</sup> (rebar)**

Anchor size reinforcing bar			Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 25
<b>Non-cracked concrete C20/25 Hammer Drilling (HD)</b>									
Temperature range I: 40°C/24°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,02	0,02	0,02	0,05	0,05	0,05	0,05
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,06	0,06	0,06	0,16	0,17	0,17	0,19
Temperature range II: 60°C/40°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,03	0,01	0,03	0,08	0,08	0,03	0,09
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,10	0,05	0,10	0,27	0,27	0,11	0,30
<b>Non-cracked concrete C20/25 Hollow Drilling (HDB)</b>									
Temperature range I: 40°C/24°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,01	0,02	0,03	0,04	0,04	0,04	0,05
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,04	0,07	0,09	0,13	0,13	0,14	0,16
Temperature range II: 60°C/40°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,02	0,03	0,04	0,06	0,06	0,07	0,08
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,07	0,11	0,15	0,21	0,21	0,23	0,26
<b>Non-cracked concrete C20/25 Diamond Drilling (DD)</b>									
Temperature range I: 40°C/24°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,01	0,01	0,01	0,02	0,02	0,02	0,03
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,04	0,03	0,03	0,06	0,06	0,08	0,11
Temperature range II: 60°C/40°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,02	0,02	0,01	0,03	0,03	0,04	0,05
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,06	0,05	0,04	0,10	0,10	0,14	0,17
<b>Cracked concrete C20/25 Hammer Drilling (HD) and Hollow Drilling (HDB)</b>									
Temperature range I: 40°C/24°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	-	0,03	0,04	0,04	0,06	0,08	
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	-	0,06	0,06	0,06	0,09	0,12	
Temperature range II: 60°C/40°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	-	0,05	0,07	0,07	0,10	0,13	
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	-	0,10	0,10	0,10	0,15	0,19	
<b>Cracked concrete C20/25 Diamond Drilling (DD)</b>									
Temperature range I: 40°C/24°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	-	0,02	0,04	0,04	0,05	0,07	
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	-	0,04	0,06	0,06	0,08	0,10	
Temperature range II: 60°C/40°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	-	0,04	0,07	0,07	0,09	0,11	
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	-	0,07	0,10	0,10	0,13	0,16	

<sup>1)</sup> Calculation of the displacement

$$\delta_{N0} = \delta_{N0}\text{-factor} \cdot \tau; \quad \tau: \text{action bond stress for tension}$$

$$\delta_{N\infty} = \delta_{N\infty}\text{-factor} \cdot \tau;$$

**Chemfix 100 and Chemfix 600 Injection System for concrete**

**Performances**

Displacements under tension load (rebars)

**Annex C8**

**Table C9: Displacement under shear load<sup>1)</sup> (rebar)**

Anchor size reinforcing bar			Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 25
<b>Non-cracked concrete C20/25</b>									
Temperature range I: 40°C/24°C	δ <sub>v0</sub> -factor	[mm/(kN)]	0,06	0,05	0,05	0,04	0,04	0,04	0,03
	δ <sub>v∞</sub> -factor	[mm/(kN)]	0,09	0,08	0,08	0,06	0,06	0,05	0,05
Temperature range II: 60°C/40°C	δ <sub>v0</sub> -factor	[mm/(kN)]	0,06	0,05	0,05	0,04	0,04	0,04	0,03
	δ <sub>v∞</sub> -factor	[mm/(kN)]	0,09	0,08	0,08	0,06	0,06	0,05	0,05
<b>Cracked concrete C20/25</b>									
Temperature range I: 40°C/24°C	δ <sub>v0</sub> -factor	[mm/(kN)]	-	-	0,11	0,11	0,10	0,09	0,08
	δ <sub>v∞</sub> -factor	[mm/(kN)]	-	-	0,17	0,16	0,15	0,14	0,12
Temperature range II: 60°C/40°C	δ <sub>v0</sub> -factor	[mm/(kN)]	-	-	0,11	0,11	0,10	0,09	0,08
	δ <sub>v∞</sub> -factor	[mm/(kN)]	-	-	0,17	0,16	0,15	0,14	0,12

<sup>1)</sup> Calculation of the displacement

$$\delta_{v0} = \delta_{v0\text{-factor}} \cdot V; \quad V: \text{action shear load}$$

$$\delta_{v\infty} = \delta_{v\infty\text{-factor}} \cdot V;$$

**Chemfix 100 and Chemfix 600 Injection System for concrete**

**Annex C9**

**Performances**

Displacements under shear load (rebars)

**Table C10: Resistance to fire**

ESSENTIAL CHARACTERISTICS	PERFORMANCE
Resistance to fire	NPD

**Table C11: Reaction to fire**

ESSENTIAL CHARACTERISTICS	PERFORMANCE
Reaction to fire	In the final application, the thickness of the mortar layer is about 1 to 2 mm and most of the mortar is material classified class A1 according to EC Decision 96/603/EC. Therefore, it may be assumed that the bonding material (synthetic mortar or a mixture of synthetic mortar and cementitious mortar) in connection with the metal anchor in the end use application do not contribute to fire growth or to the fully developed fire and they have no influence to the smoke hazard.

**Chemfix 100 and Chemfix 600 Injection System for concrete**

**Performances**  
Performance for exposure to fire

**Annex C10**